

Gateway ModBUS TCP / ModBUS RTU

MANUAL:

To obtain the complete manual please go to

www.adfweb.com/download


OR

<http://www.adfweb.com/download/filefold/Modbus TCP Server RTU Master MN67007 ENG.pdf>

To obtain the new version of this box sheet please go to

<http://www.adfweb.com/download/filefold/BS67007 ENG.pdf>

CONNECTION SCHEME

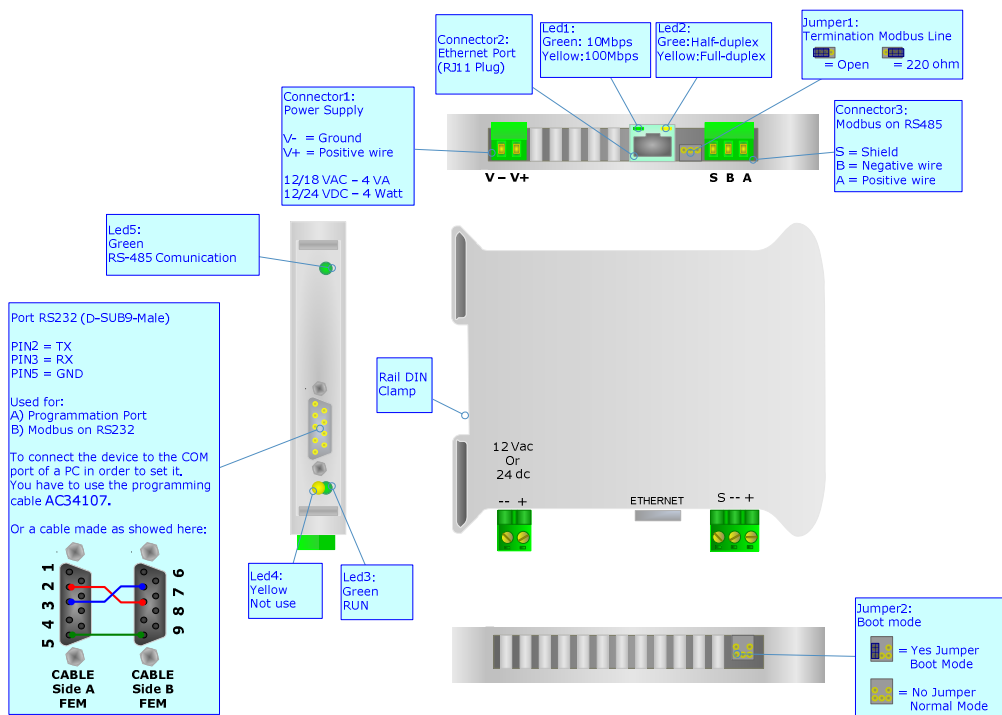

SOFTWARE:

For setting up the device you need the software named SW7007. To obtain this software please go to

<http://www.adfweb.com/download>


OR

<http://www.adfweb.com/download/filefold/SW67007.zip>

CHARACTERISTICS OF THE CABLES:

The connection from RS232 socket to a serial port must be made with a NULL MODEM cable (a serial cable where the pins 2 and 3 are crossed).

It is recommended that the RS232 Cable not exceed 15 meters.



ADFweb.com s.r.l.
 www.adfweb.com
 info@adfweb.com
 support@adfweb.com